



### **GBFVR1721** Vandal-Resistant WideArea™ Eye/Face Wash, Barrier-Free, Wall Mounted



**Application:** WideArea™ eye/face wash with vandal-resistant construction. Ideal for use in schools and other areas where equipment may be subject to abuse. All threaded connections are secured with set screws or cement to prevent disassembly.

**ADA Compliance:** When installed at recommended mounting height, unit complies with ADA requirements for accessibility by handicapped persons (maximum height and reach, minimum knee clearance and distance from obstructions).

**Spray Head Assembly:** Four vandal-resistant GS-Plus™ spray heads. Each head has a brass body, stainless steel “flip top” dust cover, internal flow control and filter to remove impurities from the water flow. Spray heads have retaining ring with set screw to protect internal components.

**Valve:** 1/2" IPS brass stay-open ball valve. Valve is US-made with chrome plated brass ball and PTFE seals.

**Bowl:** 11-1/8" diameter stainless steel with wraparound skirt and bottom panel with one-way screws.

**Mounting:** Welded stainless steel wall bracket.

**Supply:** 1/2" NPT female inlet.

**Waste:** 1-1/2" OD chrome plated brass tailpiece.

**Sign:** ANSI-compliant identification sign.

**Quality Assurance:** Unit is completely assembled and water tested prior to shipment.


#### Available Options

**T** Chrome plated brass tailpiece and trap with 1-1/2" IPS waste connection.

**G3600LF** Thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2014. Refer to “Tempering Valves” section for complete technical and product selection information.



### GBFVR1721 Vandal-Resistant WideArea™ Eye/Face Wash, Barrier-Free, Wall Mounted

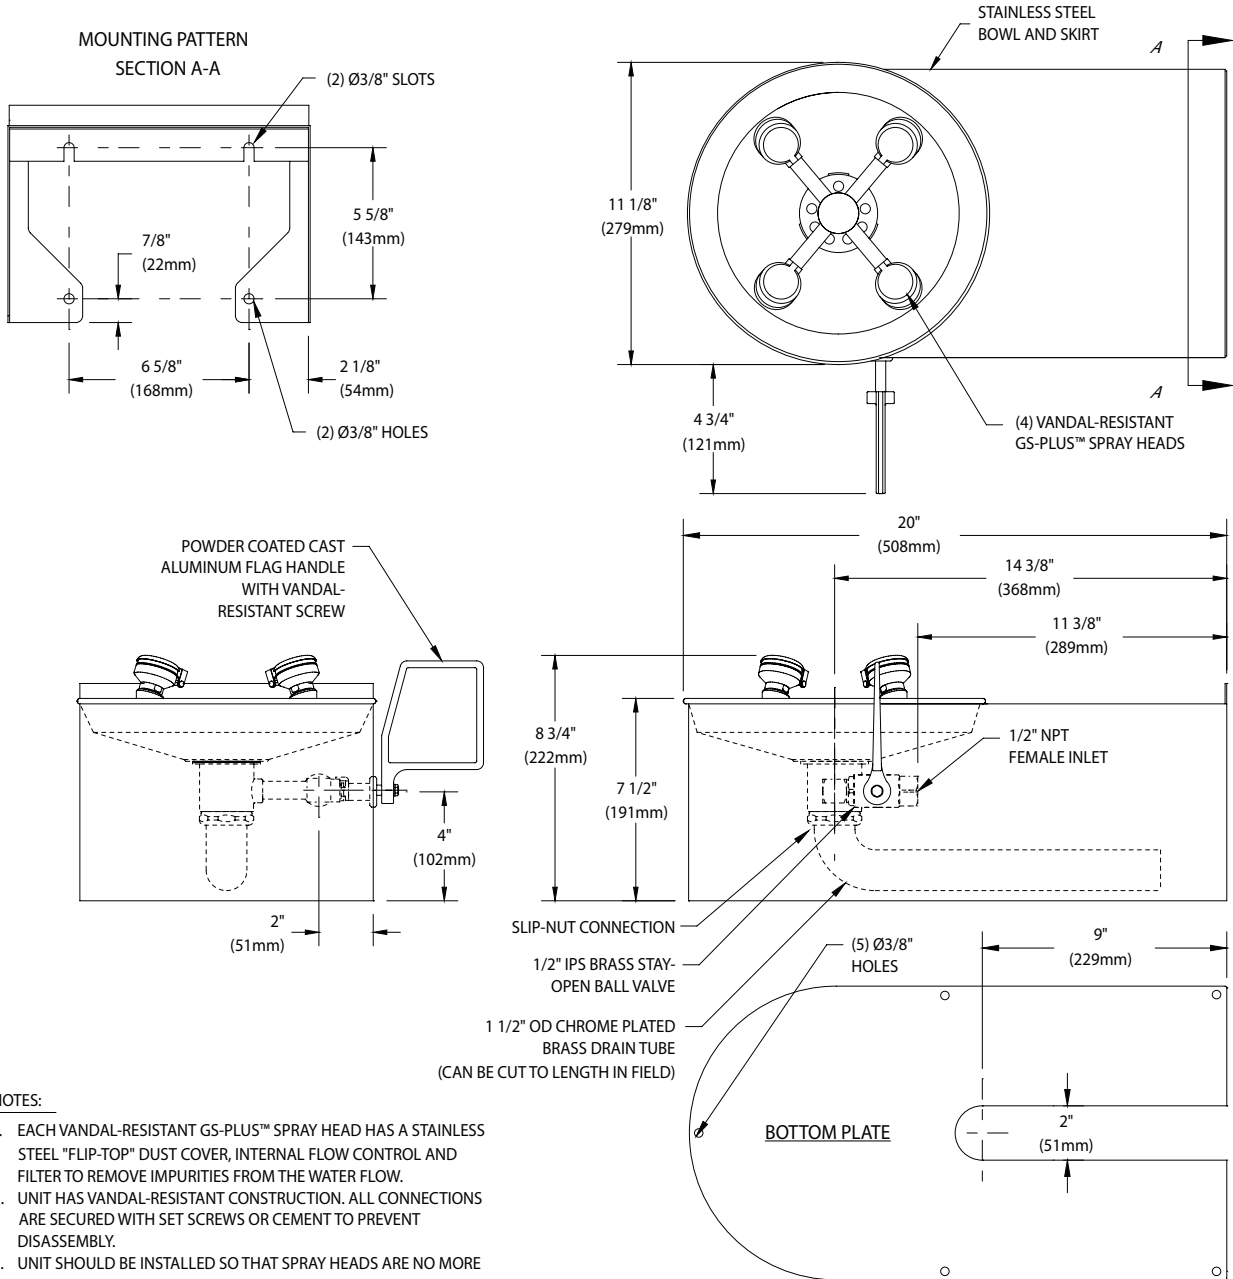

**NOTES:**

1. EACH VANDAL-RESISTANT GS-PLUS™ SPRAY HEAD HAS A STAINLESS STEEL "FLIP-TOP" DUST COVER, INTERNAL FLOW CONTROL AND FILTER TO REMOVE IMPURITIES FROM THE WATER FLOW.
2. UNIT HAS VANDAL-RESISTANT CONSTRUCTION. ALL CONNECTIONS ARE SECURED WITH SET SCREWS OR CEMENT TO PREVENT DISASSEMBLY.
3. UNIT SHOULD BE INSTALLED SO THAT SPRAY HEADS ARE NO MORE THAN 36" ABOVE FINISHED FLOOR.

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL



Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are ± 1/4" (6mm). rev. 1017

