

GFR3100 Heated Safety Station with Eyewash, Top Inlet, Rated for Class I, Division 2 Environment

Application: Electric heat-traced stations prevent freezing even in extreme conditions. Thermostat regulated units are heated by self-limiting heat-tracing cable wrapped around internal pipe. Units are intended for cold weather use down to -40°F. See 'Tempering Valves' section to ensure tepid water compliance with ANSI Z358.1-2014.

Heating Cable: Self-regulated with external termination guards. Thermostat activates when internal piping temperature falls below 75°F. FM, UL, and CSA approved for Class I, Division 2, Groups B, C, and D.

Electrical System: Unit is fully wired at factory. Junction box and components rated for Class I, Division 2, Groups B, C, and D. Requires 120 VAC single phase power supply.

Jacket/Insulation: UV-resistant orange ABS plastic with polyethylene foam insulation. Jacket sections secured with removable stainless steel screws for easy maintenance.

Shower Head: 10" diameter orange ABS plastic with 20 GPM flow control.

Shower Valve: 1" IPS brass stay-open ball valve. US-made with brass ball and Teflon® seals. Includes stainless steel actuating arm and 29" stainless steel pull rod.

Spray Head Assembly: Freeze-resistant with float-off dust covers and internal flow control.

Eyewash Valve: 1/2" IPS brass three-way self-draining stayopen ball valve. US-made with brass ball and Teflon® seals. Includes 1/2" NPT port to drain water from spray heads after use.

Pipe and Fittings: Schedule 40 galvanized steel.

Supply: 1-1/4" NPT female top inlet.

Sign: ANSI-compliant identification sign.

Quality Assurance: Factory tested prior to shipment. Ships

fully assembled and crated.

Available Options

Stainless steel shower head.
HV 240 volt heat tracing.
TL Heat trace indicator light.
SP Scald protection valve.
FP Freeze protection valve.
ALG Green area light.
PS Magnetically activated proximity (MAP) switch.

Distributed by: Safety Emporium

PO Box 1003 Blackwood, NJ 08012 Ph: (866) 326-5412 toll-free Fax: (856) 553-6154

esupport@safetyemporium.com

www. safetyemporium.com



Alarm Options

Specify desired alarm using fourth digit of model number, as follows:

- O No alarm
- 1 Single pole, double throw flow switch for remote sensing capability
- 3 Alarm horn and remote sensing capability
- 5 Light and remote sensing capability
- 7 Alarm horn, light and remote sensing capability






101496. Units have been

ANSI Z358.1-2014.



GFR3100 Heated Safety Station with Eyewash, Top Inlet, Rated for Class I, Division 2 Environment

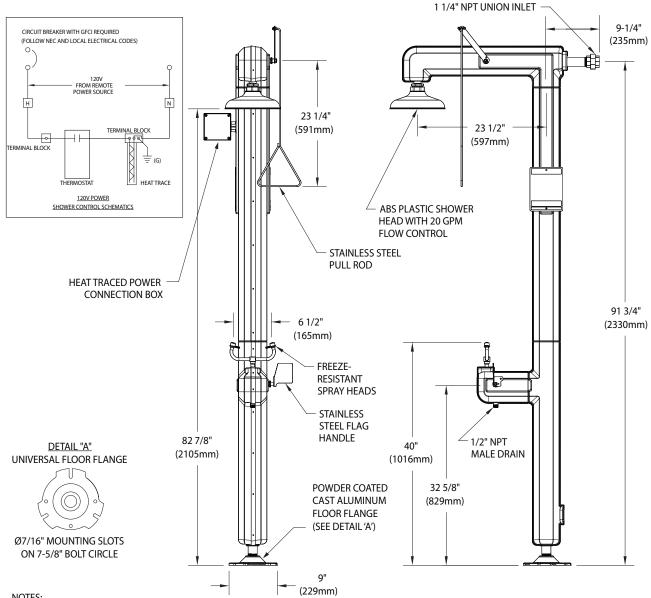

NOTES:

- 1. FREEZE RESISTANT SPRAY HEAD ASSEMBLY HAS AN INTERNAL FLOW CONTROL
- 2. DESIGNED FOR USE IN A CLASS I, DIVISION 2, GROUPS B, C, & D ENVIRONMENT.
- 3. PEAK HEAT TRACE POWER CONSUMPTION IS 75 WATTS.
- 4. IN ORDER TO MEET CLASS I, DIVISION 2 REQUIREMENTS, APPROVED CONDUIT AND FITTINGS MUST BE USED. ALL THREADED ELECTRICAL CONNECTIONS MUST HAVE HAZARDOUS LOCATION RATED SEALANT APPLIED TO THREADS.

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL



UPC listed 8116. ETL listed 101496. Units have been tested to and comply with ANSI Z358.1-2014.



Sign Included

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are $\pm 1/4$ " (6mm). rev. 0116