

## GFR3200 Heated Safety Station with Eyewash, Top Inlet, Rated for Class I, Division 1 Environment

**Application:** Class I, Division 1 rated electric heat-traced stations prevent freezing in extremely hazardous, cold weather conditions where flammable gases are routinely expected. Thermostat regulated units are heated by self-limiting heat-tracing cable wrapped around internal pipe. Units are intended for cold weather use down to -40°F. See 'Tempering Valves' section to ensure tepid water compliance with ANSI Z358.1-2014.

Heating Cable: Self-regulated with external termination guards. Thermostat activates when internal piping temperature falls below 50°F. FM, UL, and CSA approved for Class I, Division 1, Groups B, C, and D.

**Electrical System:** Unit is fully wired at factory. Junction box and components rated for Class I, Division 1, Groups B, C, and D. Requires 120 VAC single phase power supply. Heat-trace indicator light included. Note: In order to meet Class I, Division 1 requirements, approved conduit and fittings must be used during installation.

**Jacket/Insulation:** UV-resistant orange ABS plastic with polyethylene foam insulation. Jacket sections are secured with removable stainless steel screws for easy maintenance.

Shower Head: 10" diameter orange ABS plastic with 20 GPM flow control.

Shower Valve: 1" IPS brass stay-open ball valve. US-made with brass ball and PTFE seals. Includes stainless steel actuating arm and 29" stainless steel pull rod.

Spray Head Assembly: Freeze-resistant with float-off dust covers and internal flow control.

**Eyewash Valve:** 1/2" IPS brass three-way self-draining stay-open ball valve. US-made with brass ball and PTFE seals. Includes 1/2" NPT port to drain water from spray heads after use.

Pipe and Fittings: Schedule 40 galvanized steel.

Supply: 1-1/4" NPT female top inlet.

Sign: ANSI-compliant identification sign.

Quality Assurance: Factory tested prior to shipment. Ships fully assembled and crated.

## **Available Options**

**SSH** Stainless steel shower head

- **GRN** Green ABS plastic shower head and shell
- HV 240 volt heat-tracing

**TL** Heat-trace indicator light

SP Scald protection valve

**FP** Freeze protection valve

ALC Clear Area Light (ships separately from unit)

**G3800LF** Thermostatic mixing valve. *Note: Must be* installed in a non-freezing environment.

Guardian Equipment 1140 N North Branch St 312 447 8101 FACSIMILE Chicago, IL 60642 gesafety.com

Distributed by: Safety Emporium PO Box 1003 Blackwood, NJ 08012 Ph: (866) 326-5412 toll-free Fax: (856) 553-6154 esupport@safetyemporium.com www.safetyemporium.com

## Alarm Options

Specify desired alarm using fourth digit of model number, as follows:

- 0 No alarm
- 1 Single pole, double throw flow switch for remote sensing capability






312 447 8100 TELEPHONE



## GFR3200 Heated Safety Station with Eyewash, Top Inlet, Rated for Class I, Division 1 Environment

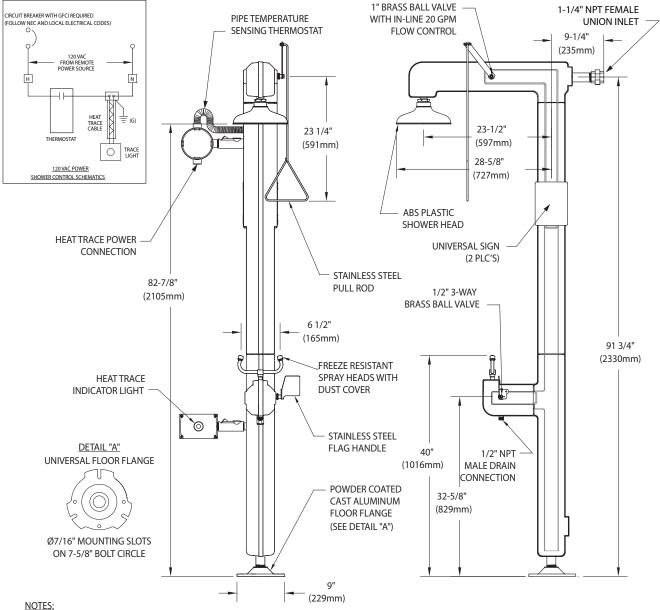

1. FREEZE RESISTANT SPRAY HEAD ASSEMBLY WITH INTERNAL 3.2 GPM FLOW CONTROL AND FLOAT OFF DUST COVERS.

- 2. DESIGNED FOR USE IN A CLASS I, DIVISION 1, GROUPS B, C & D ENVIRONMENT.
- 3. PEAK HEAT TRACE POWER CONSUMPTION IS 80 WATTS.
- 4. IN ORDER TO MEET CLASS I, DIVISION 1 REQUIREMENTS, APPROVED CONDUIT AND FITTINGS MUST BE USED.
  - ALL THREADED ELECTRICAL CONNECTIONS MUST HAVE HAZARDOUS LOCATION RATED SEALANT APPLIED TO THREADS.

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL	Distributed by: Safety Emporium PO Box 1003 Blackwood, NJ 08012 Ph: (866) 326-5412 toll-free Fax: (856) 553-6154	Sign Included
Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are $\pm 1/4$ " (6mm). rev. 041819	esupport@safetyemporium.com www.safetyemporium.com	receipt and characteristic strategy of the str



Listed 8116. Units have been tested to and comply with ANSI Z358.1-2014 and the Uniform Plumbing Code.

